

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400

TEST REPORT

Client : The Mat Group
9-11 Shearson Cres,
Mentone VIC 3194

Test Number : 22-003965
Issue Date : 2/11/2022
Print Date : 3/11/2022
Order Number : awta31022rg

Sample Description Clients Ref : "HydraSorb"
Entrance Matting
Colour : Charcoal
End Use : Entrance Matting
Nominal Composition : Foam backed Polypropylene and Polyester
Nominal Mass per Unit Area/Density : 2000g/m2
Nominal Thickness : 10mm

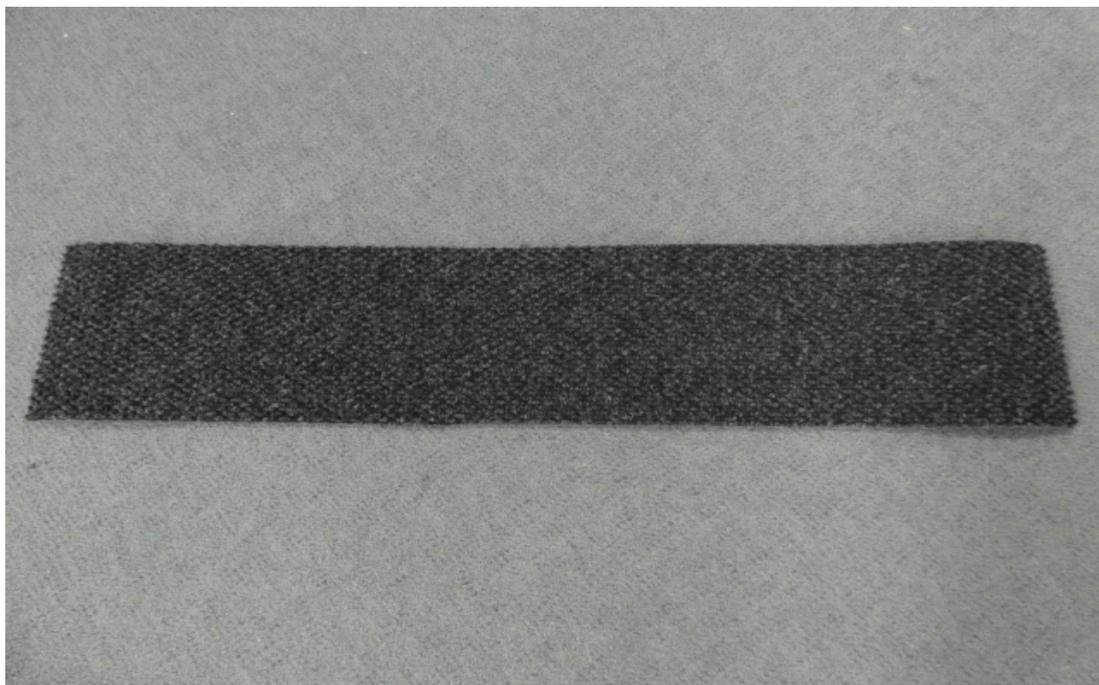

281891

60913

Page 1 of 2

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved

Samples, and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. The above test results are designed to provide THE CLIENT WITH GUIDANCE INFORMATION ONLY. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved in advance by the Managing Director of AWTA Ltd.



Chris Campbell

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031
P.O Box 240, North Melbourne, Victoria 3051
Phone (03) 9371 2400

TEST REPORT

Client : The Mat Group
9-11 Shearson Cres,
Mentone VIC 3194

Test Number : 22-003965
Issue Date : 2/11/2022
Print Date : 3/11/2022
Order Number : awta31022rg

**AS ISO 9239.1-2003
(Modified Guidance)**

**Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a
Radiant Heat Source**

Date of Sample Arrival 12-10-2022
Date Tested 28-10-2022

CHF Value	
Length	≤1.1 kW/m ²
Smoke Value	
Length	588 %min
Melting	Yes

Each specimen was adhered to a substrate of 6mm thick fibre reinforced cement board using Roberts 656 adhesive and clamped prior to testing.

HF30 not reported as flame out time occurred before 30 minutes.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2010 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

281891

60913

Page 2 of 2

© Australian Wool testing Authority Ltd
Copyright - All Rights Reserved

Samples, and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. The above test results are designed to provide THE CLIENT WITH GUIDANCE INFORMATION ONLY. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved in advance by the Managing Director of AWTA Ltd.



Chris Campbell

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)
MANAGING DIRECTOR